


NOTES :

- ⑥ See Standard Drawing 604-SWCR-02 for groove details.
- ⑦ See Standard Drawing 604-SWCR-02 for details of the detectable warnings.
- ⑧ A minimum 1200 mm landing area shall be provided at the bottom of the ramp for wheelchair users.
- ⑨ Indicated area denotes pay limits.
- ⑩ Curb or wall shall be used when necessary based on field conditions.
11. See Standard Drawings 604-SWCR-03 for typical ramp construction details.
12. See Standard Drawings 604-SWCR-01 and -02 for Location Plan and General Notes respectively.

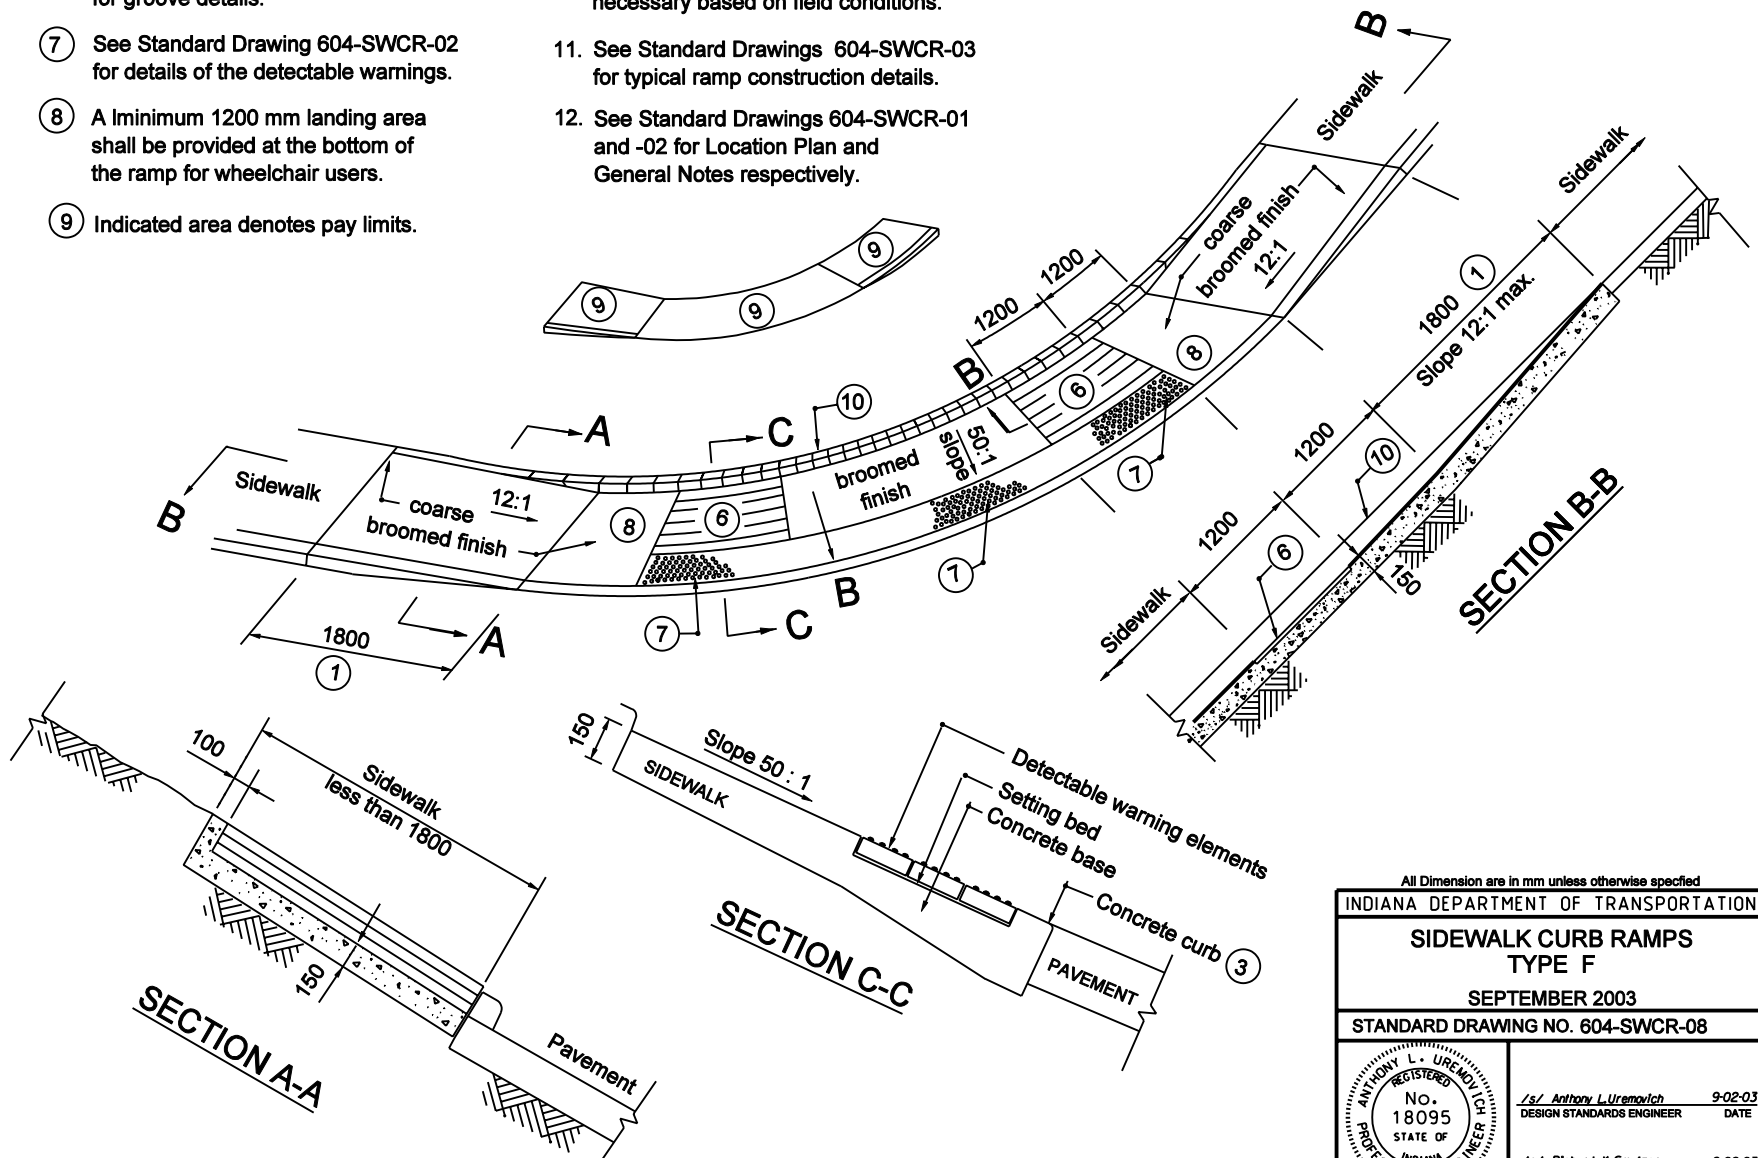


All Dimension are in mm unless otherwise specified

INDIANA DEPARTMENT OF TRANSPORTATION

SIDEWALK CURB RAMPS TYPE F

SEPTEMBER 2003

STANDARD DRAWING NO. 604-SWCR-08



/s/ Anthony L. Uremovich 9-02-03
DESIGN STANDARDS ENGINEER DATE

/s/ Richard K. Smutzer 9-02-03
CHIEF HIGHWAY ENGINEER DATE

DESIGN STANDARDS ENGINEER